


TAV-20

FILM Type Filling for Cooling Tower

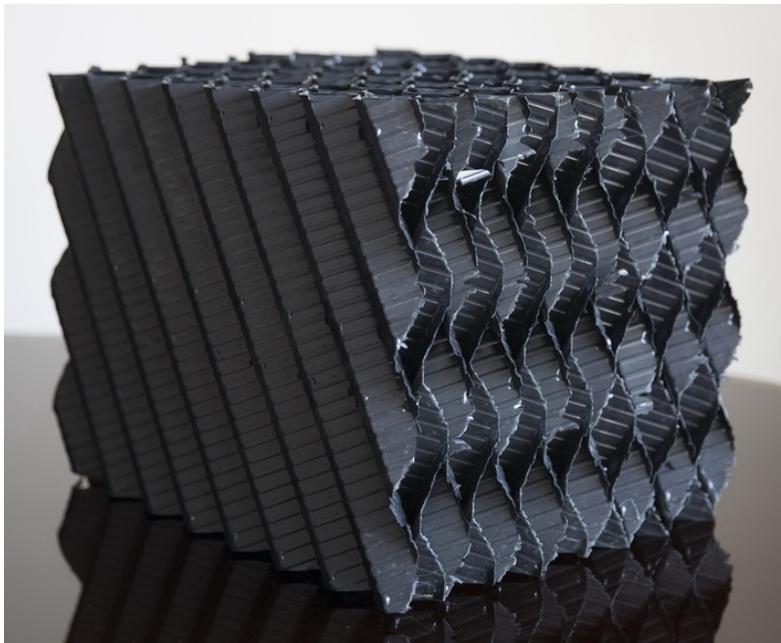

Flute Height (mm)	Exchange Surface (M ² /M ³)	Minimum Water Load For Cooling Tower (M ³ /HR)/M ²	Sheet thickness before thermoforming (Micron)	Voidage	Material
20	140	5.5	300/400/500	97%	PVC According to CTI Standard STD-136 (00)